

Sensitive Buildings

Instructor: Rob Faludi

Plan for Today

- Romance Light Sensors: review
- API Mode continued...
 - API for I/O Mode Details
- Simple Sensor Network
- Readings & Assignments


Romance Light Sensors: review

Jordan Husney: Digi History & Solutions

More API


TX (Transmit) Request

- Remember that this is a request. Results can be checked by Frame ID

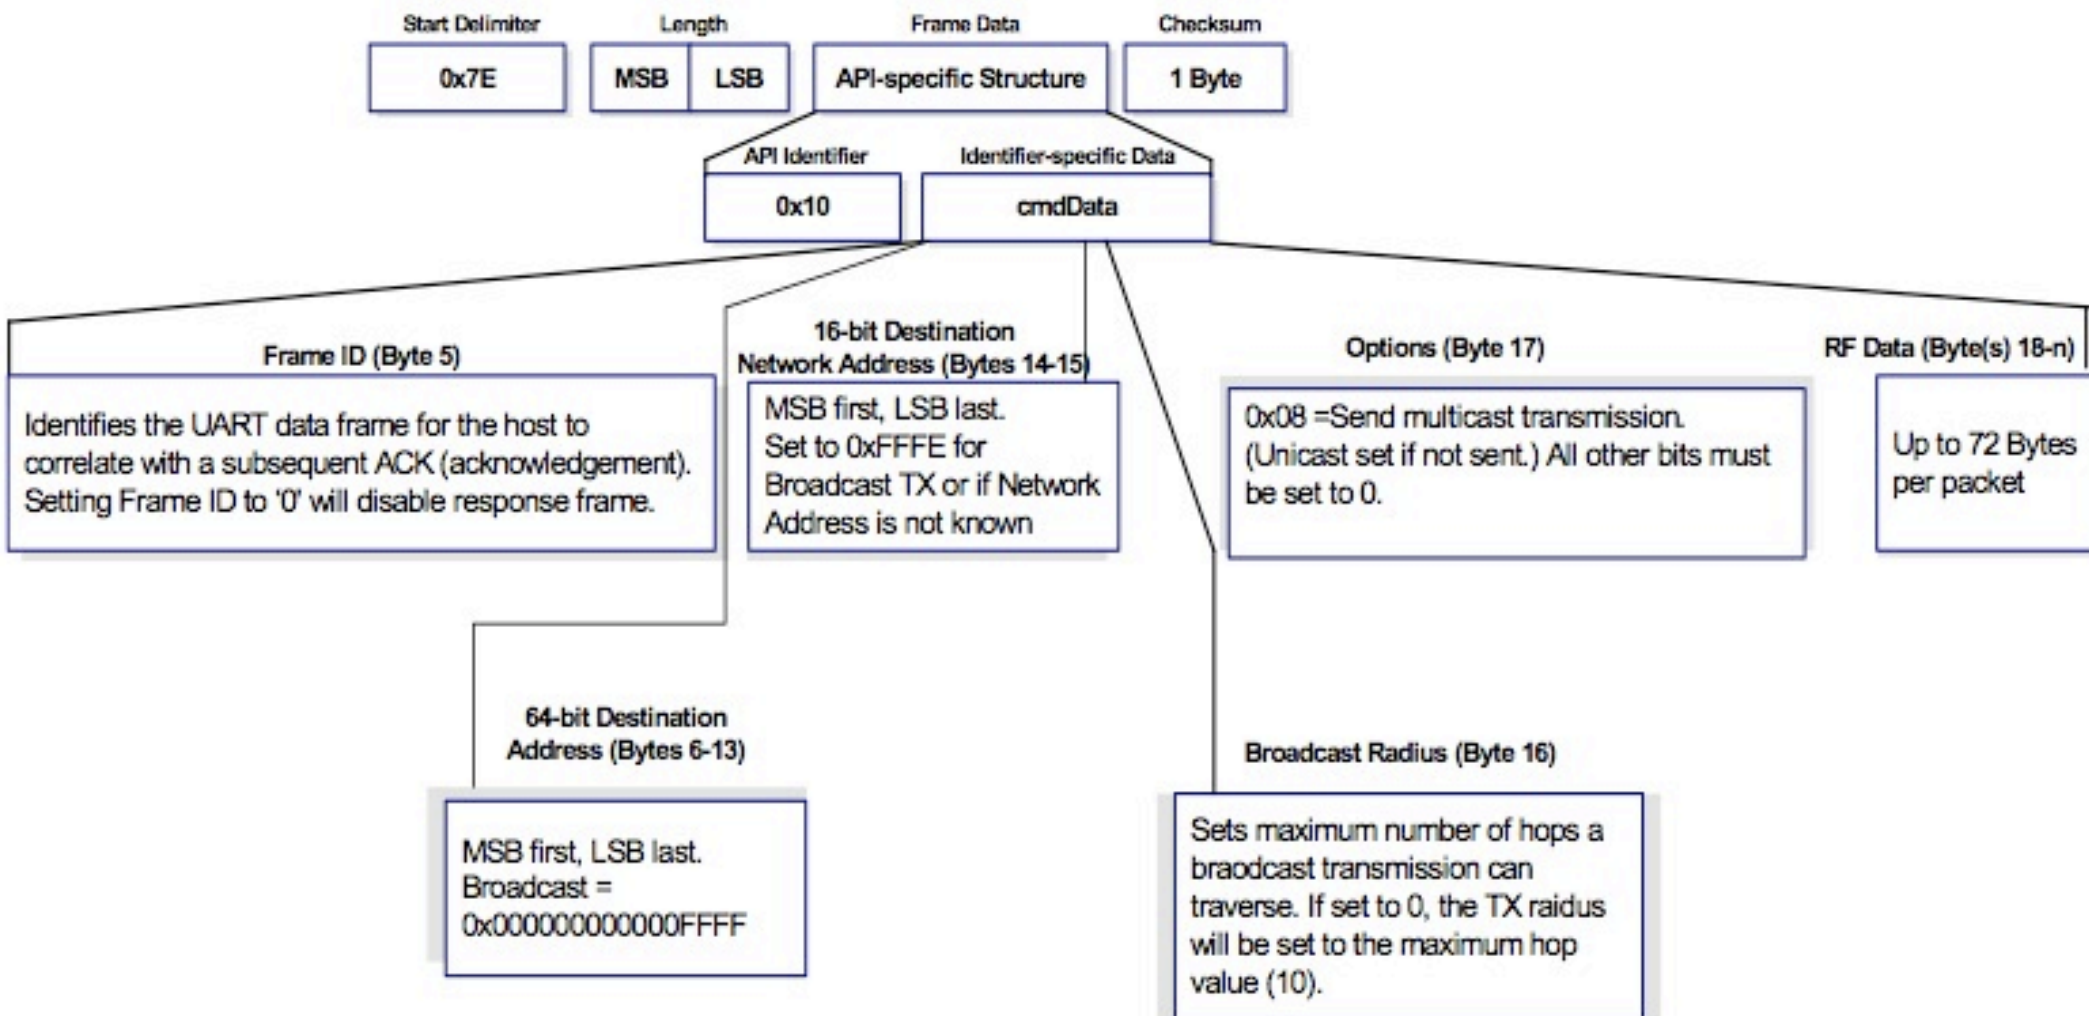

TX Status (Results)



- See if your message was transmitted or not
- Use your Frame ID to see which message is being described

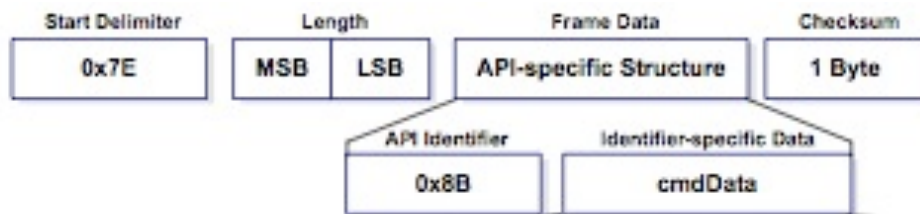


Frame ID (Byte 5)	Remote Network Address (Bytes 6-7)	Transmit Retry Count (Byte 8)	Delivery Status (Byte 9)	Discovery Status (Byte 10)
Identifies UART data frame being reported.	16-bit Network Address the packet was delivered to (if success). If not success, this address matches the Destination Network Address that was provided in the Transmit Request Frame.	The number of application transmission retries that took place.	0x00 = Success 0x02 = CCA Failure 0x15 = Invalid destination endpoint 0x21 = Network ACK Failure 0x22 = Not Joined to Network 0x23 = Self-addressed 0x24 = Address Not Found 0x25 = Route Not Found	0x00 = No Discovery Overhead 0x01 = Address Discovery 0x02 = Route Discovery 0x03 = Address and Route Discovery

RX Packet

- Maximum of 72 bytes of data per packet
- RF Data section is basis for I/O packets

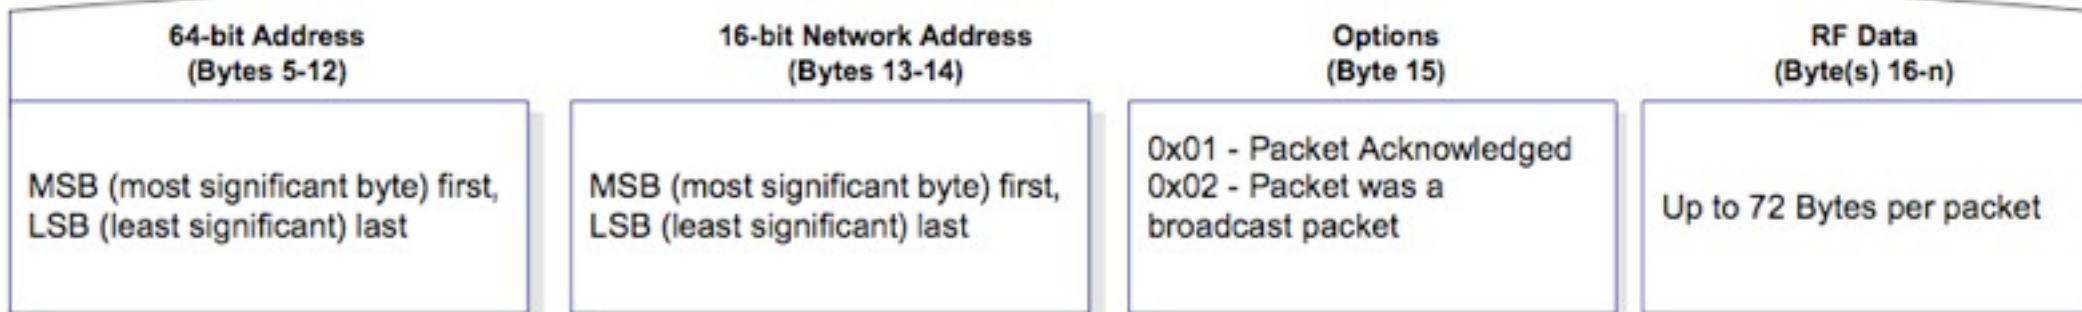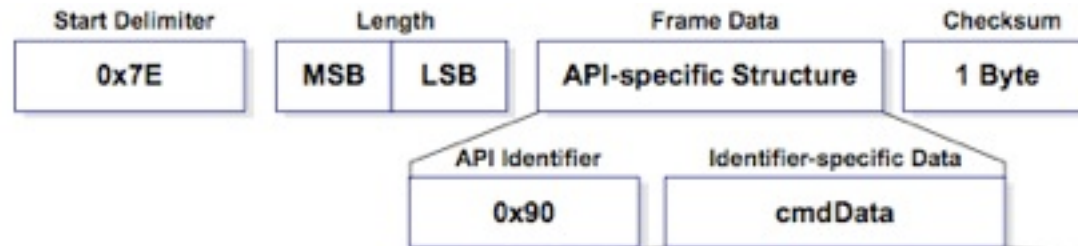

I/O RX Packet

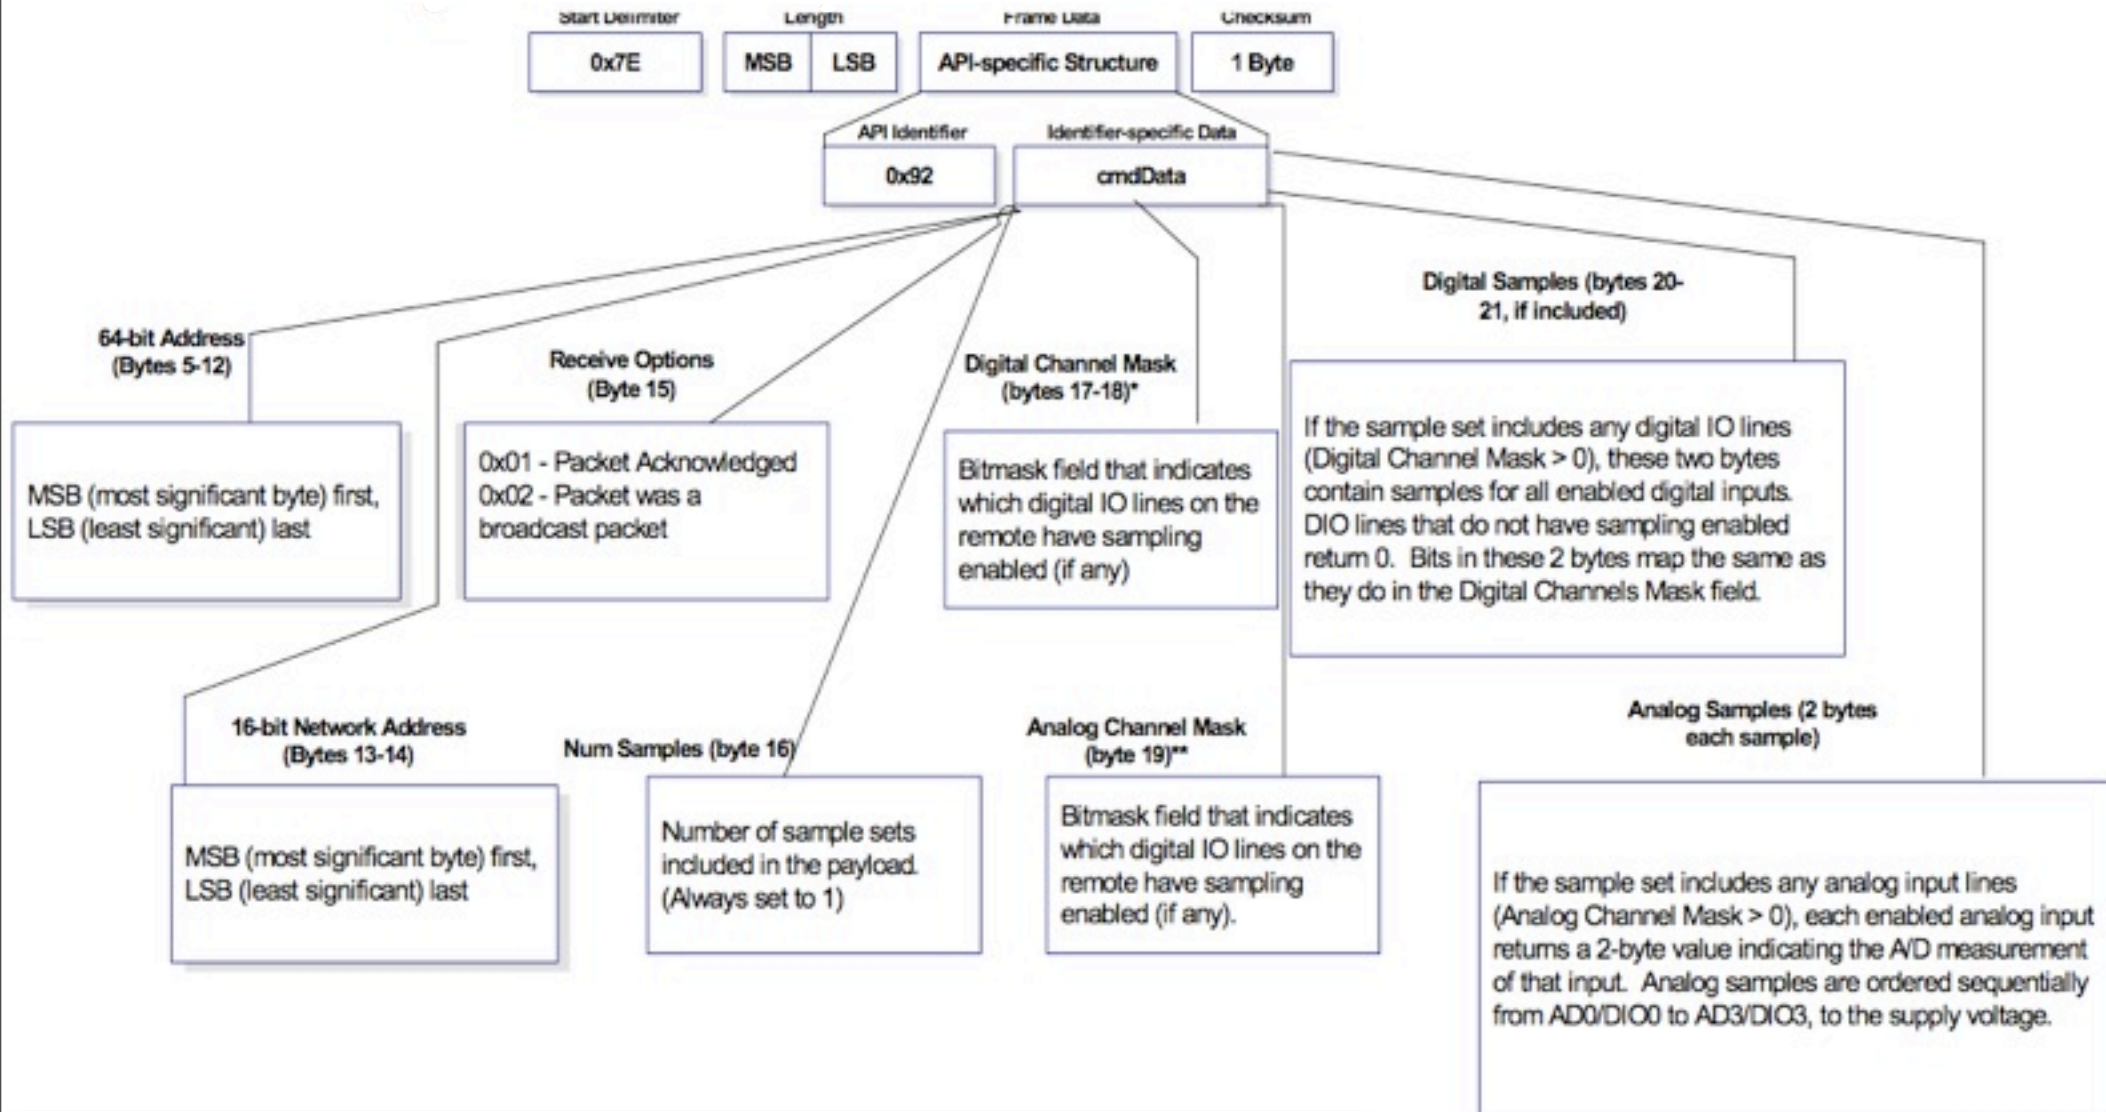

I/O Digital Channel Mask and Digital Data

Digital Channel Mask (bytes 17-18)*

Bitmask field that indicates which digital IO lines on the remote have sampling enabled (if any)

*

N/A	N/A	N/A	CD/DIO 12	PWM/DI O11	RSSI/DI O10	N/A	N/A
CTS/DI O7	RTS/DI O6	ASSOC/ DIO5	DIO4	AD3/DI O3	AD2/DI O2	AD1/DI O1	AD0/DI O0

Digital Samples (bytes 20- 21, if included)

If the sample set includes any digital IO lines (Digital Channel Mask > 0), these two bytes contain samples for all enabled digital inputs. DIO lines that do not have sampling enabled return 0. Bits in these 2 bytes map the same as they do in the Digital Channels Mask field.

I/O Analog Channel Mask and Analog Samples

Analog Channel Mask (byte 19)**

Bitmask field that indicates which digital IO lines on the remote have sampling enabled (if any).

**

Supply Voltage	N/A	N/A	N/A	AD3	AD2	AD1	AD0
----------------	-----	-----	-----	-----	-----	-----	-----

Analog Samples (2 bytes each sample)

If the sample set includes any analog input lines (Analog Channel Mask > 0), each enabled analog input returns a 2-byte value indicating the A/D measurement of that input. Analog samples are ordered sequentially from AD0/DIO0 to AD3/DIO3, to the supply voltage.

I/O Structure Reviewed

- Num Samples (1 byte)
 - Digital Channel Mask (2 bytes)
 - Analog Channel Mask (1 byte)
 - Two bytes of digital data IF ANY DIGITAL CHANNELS ENABLED followed by...
 - ...two bytes for EACH analog channel enabled...
-
- Q: How many bytes ATD02 ATD12 ATD23

Simple Sensor Network

Readings and Assignments

- Readings
 - “How Management Teams Can Have a Good Fight”
 - Building Wireless Sensor Networks, Chapter 5
- Assignments
 - Simple Sensor Network